



- MATERIALS
- 2) ALL INVERT ELEV. & GRADES ARE REFERENCED FROM T.B.M.
  - 3) SEPTIC TANK, D-BOX & LEACHING CHAMBERS ARE TO BE SUPPLIED BY BATES & CO., CONCORD, N.H., SCOTT CONCRETE PRODUCTS, LONDONDERRY, N.H. OR EQUAL.

### TYPICAL SECTION OF PROPOSED SANITARY SYSTEM

NOT TO SCALE



#### PERFORMANCE CURVE

WHIRL SERIES WASTE HANDLING PUMPS

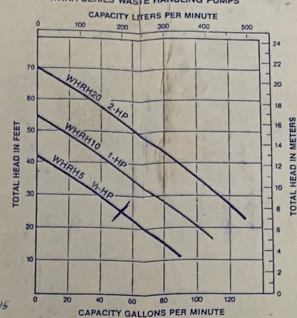

SEWER RISER AND CLEANOUT  
NO SCALE

ELIMINATOR 1600 GALLON SEPTIC TANK - TO BE SUPPLIED BY DEL. R. GILBERT, HOUSTON, NH. OR EQUAL

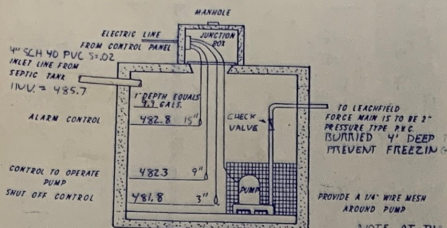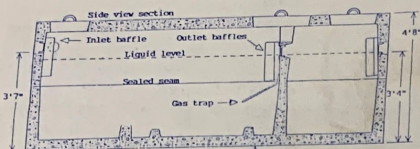

PUMP IS TO BE WHIRL 1-1/4 HP WITH 2" DISCHARGE PUMP AND CONTROLS ARE TO BE SUPPLIED BY AETNA PUMPS INC. OF AUBURN, N.H. OR EQUAL. DOSE IS SET AT 60 GALS.

PUMP CHAMBER DETAIL  
NOT TO SCALE

NOTE AT THE SEPTIC TANK THE FORCE MAIN IS TO BE ENLARGED TO A 4" LINE INTO THE SEPTIC TANK WITH A VERTICAL VELOCITY REDUCING TEE IN THE SEPTIC TANK

STATIC HEAD = 11.7'  
DYNAMIC HEAD @ 55 GPM = 13.4'  
TOTAL HEAD @ 55 GPM = 25.1'

LOT 5  
2.5 ACRES

LOT 5  
2.5 ACRES

TBM WP 1 TOP OF GRANITE BOUND  
ELEV = 476.70

ARROWHEAD DRIVE

EXISTING HOUSE

EXISTING TANK

EXISTING FIELD

PROPOSED WELL  
& ART. WELL

TBM WP 2 TOP OF GRANITE BOUND  
ELEV = 487.49

JUNE 3,

AMENDED PLAN  
LOC: HOUSE, SANITARY & WELL.

JUN 13 1991

#### LEGEND

- TEST PIT LOCATION AND NUMBER
- PERC TEST LOCATION
- PROPERTY LINES
- R.O.W. LINES
- BUILDING SETBACK LIMITS
- WATER LINE
- DRAIN LINE
- EDGE OF PAVEMENT
- EDGE OF WETLAND
- CENTERLINE OF BROOK
- CENTERLINE OF SEASONAL RUNOFF
- EDGE OF WOODS
- FENCELINE & STONEWALL
- PERFORATED PIPE
- SEPTIC TANK, D-BOX, WELL
- EXISTING CONTOUR
- SPOT ELEVATION
- PROPOSED GRADE

DOCUMENT HAS BEEN PREPARED TO ASSIST IN THE CONSTRUCTION OF A SUBSURFACE SANITARY WASTE DISPOSAL SYSTEM. PERSONS USING THIS DOCUMENT FOR USES OTHER THAN THE CONSTRUCTION OF A SURFACE SANITARY WASTE DISPOSAL SYSTEM DO SO AT THEIR OWN RISK.

DESCRIPTION	C/O	DR	CK
ADD ELIMINATOR TANK		KN	TF